



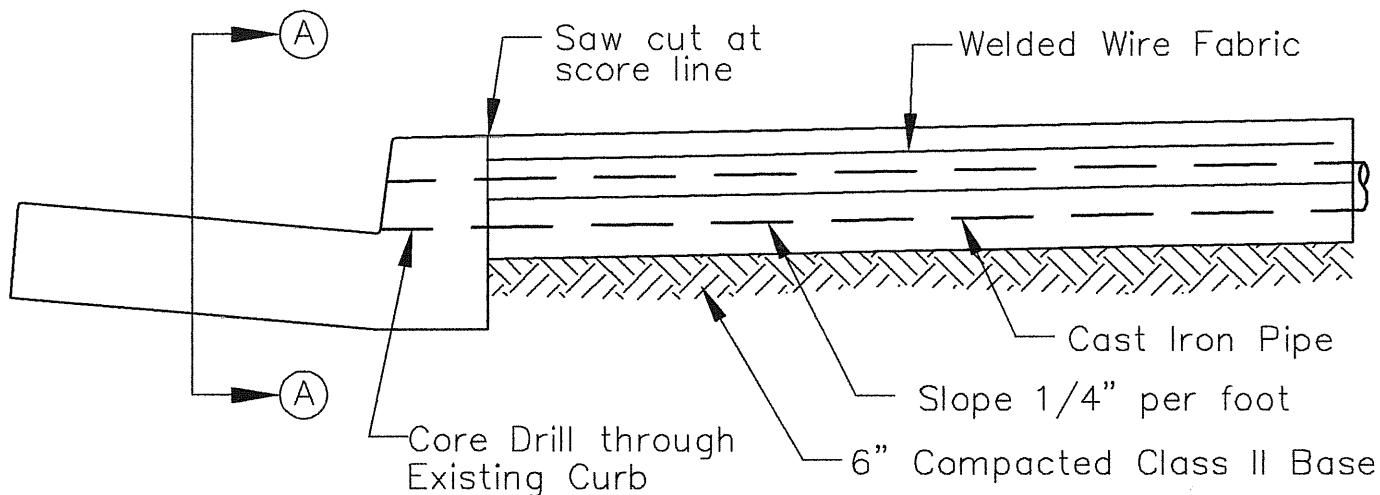

**UNDER SIDEWALK DRAIN WITH
STANDARD SIDEWALK, CURB AND GUTTER**
Scale: 1"=1'-0"

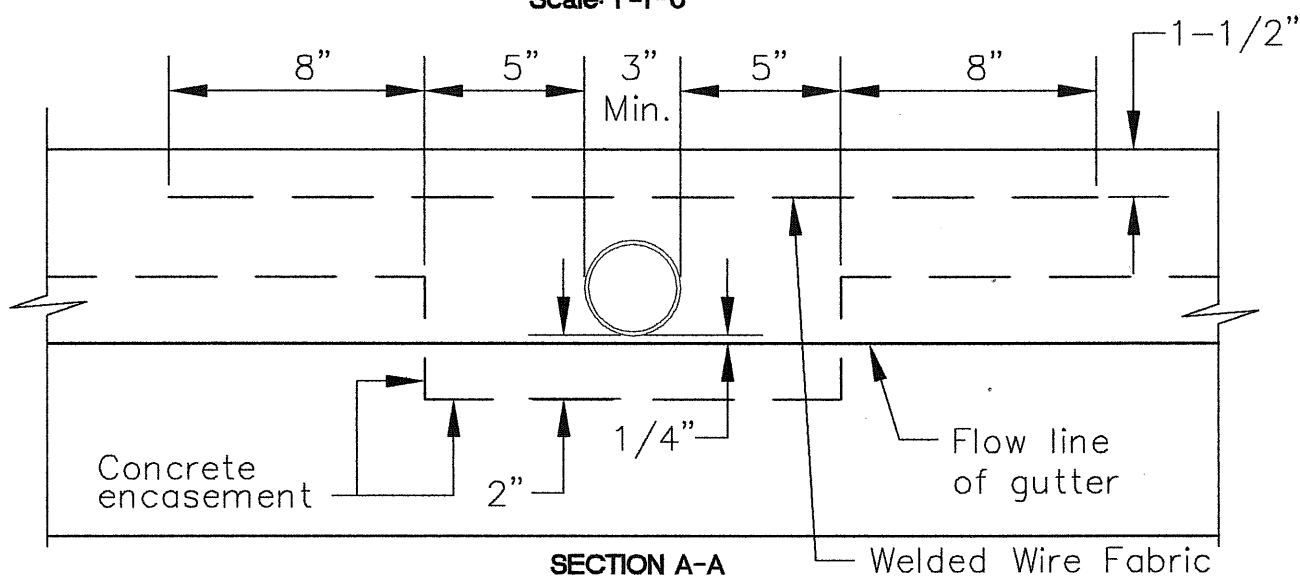

SECTION A-A
Scale: 1"=6"

NOTES

- 1) 3" Minimum Cast Iron Pipe or as Approved by the City Engineer. Core drill through existing curb.
- 2) 6"x6"-10/10 welded wire fabric.
- 3) Concrete to be class "B" per state specification, 3/4" max. aggregate
- 4) Existing sidewalk to be removed shall be cut with a concrete saw along score joints.
- 5) Score joints shall be 1/4 inch deep.
- 6) All curb, gutter & sidewalk will be replaced on a min. of 6" compacted Class II Aggregate Base. See Std. 100.
- 7) Epoxy Dowel new concrete to adjacent concrete with #4x10" deformed steel bar @ 2' O.C.

**CITY OF
PACIFICA**

DEPARTMENT OF PUBLIC WORKS
ENGINEERING DIVISION

STANDARD

UNDER SIDEWALK DRAIN
(EXISTING SIDEWALK, CURB
AND GUTTER)

△

△

△

REV

2/02

DATE

RDD

BY

**FEB
2002**

**DWG. NO.
104B**